


PLAN

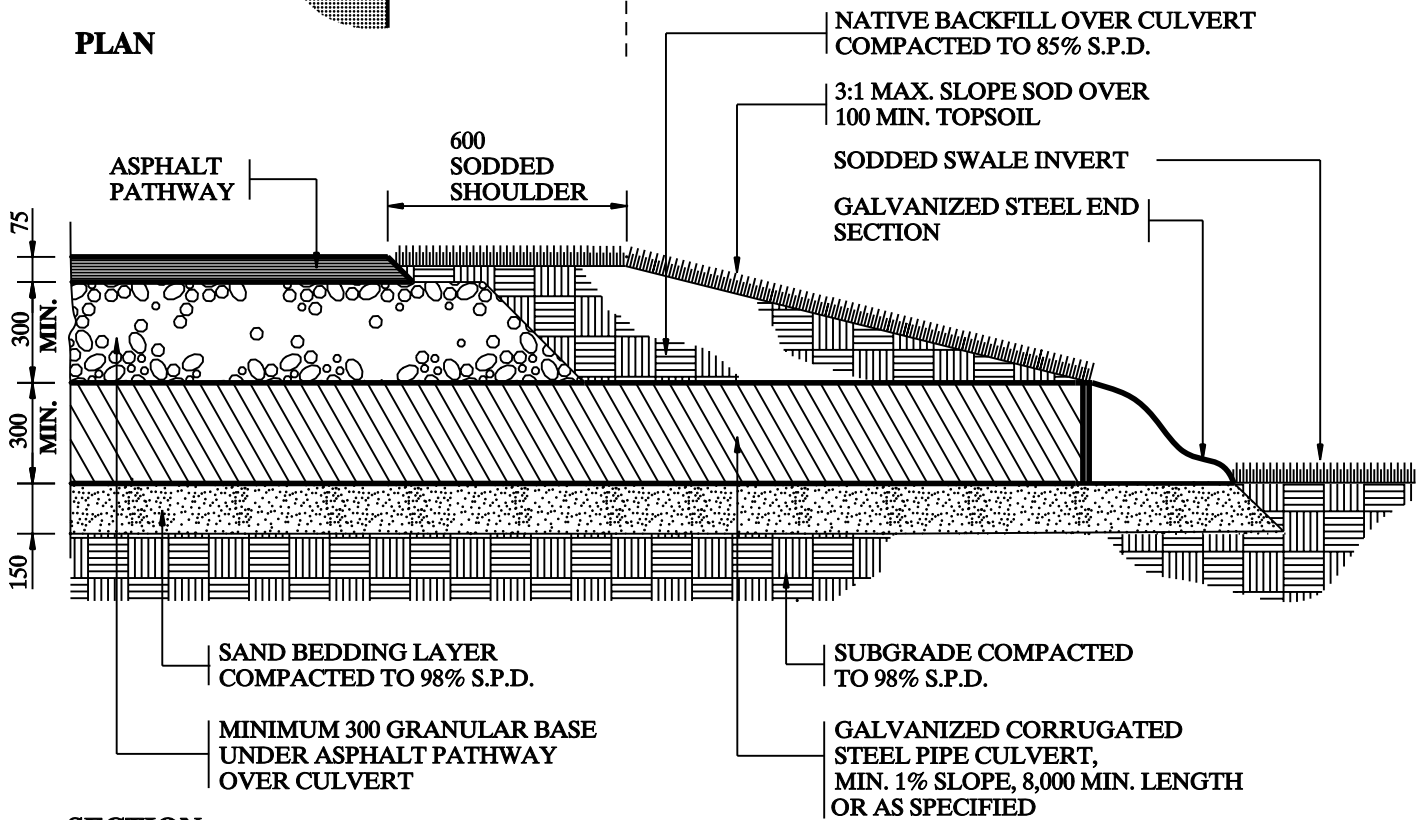

SECTION

NOTES:

1. CORRUGATED STEEL PIPE CULVERT SHALL BE GALVANIZED, 1.6mm THICK, COMPLETE WITH PREFABRICATED GALVANIZED STEEL END SECTIONS, WITH COLLAR BOLTS, BURIED BELOW GRADE
2. CULVERT TO BE 300 O.D. MINIMUM SIZE, OR AS SPECIFIED
3. INVERT ELEVATIONS OF CULVERTS MUST MATCH ELEVATIONS OF SWALE CENTER
4. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS STATED OTHERWISE



**PLANNING,
DESIGN &
DEVELOPMENT
DEPARTMENT**

TITLE:
**PATHWAY CULVERT
(PLAN & SECTION)**

DRAWING NO.
PDD 510

REVIEWED BY: *S.D. [Signature]*

SCALE: N.T.S.

APPROVED BY: *[Signature]*

DATE: JANUARY 2007