



THE CORPORATION OF THE CITY OF BRAMPTON

BY-LAW

Number 173-2000


A by-law to amend By-law 115-99
being the Smoke Free By-law

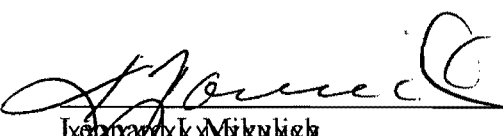
The Council of the Corporation of the City of Brampton hereby ENACTS as follows:

1. By-law 115-99 is amended as follows:
 - (1) Notwithstanding subsection 3(2), where an employer is a tobacco company, a designated smoking room, as identified on Schedule "A" hereto may be used to conduct business.


READ a FIRST, SECOND and THIRD time and PASSED in OPEN
COUNCIL, this **9th** day of August, 2000.

The Corporation of the City of Brampton


Peter Robertson Mayor


Kathryn Zammit Deputy Clerk

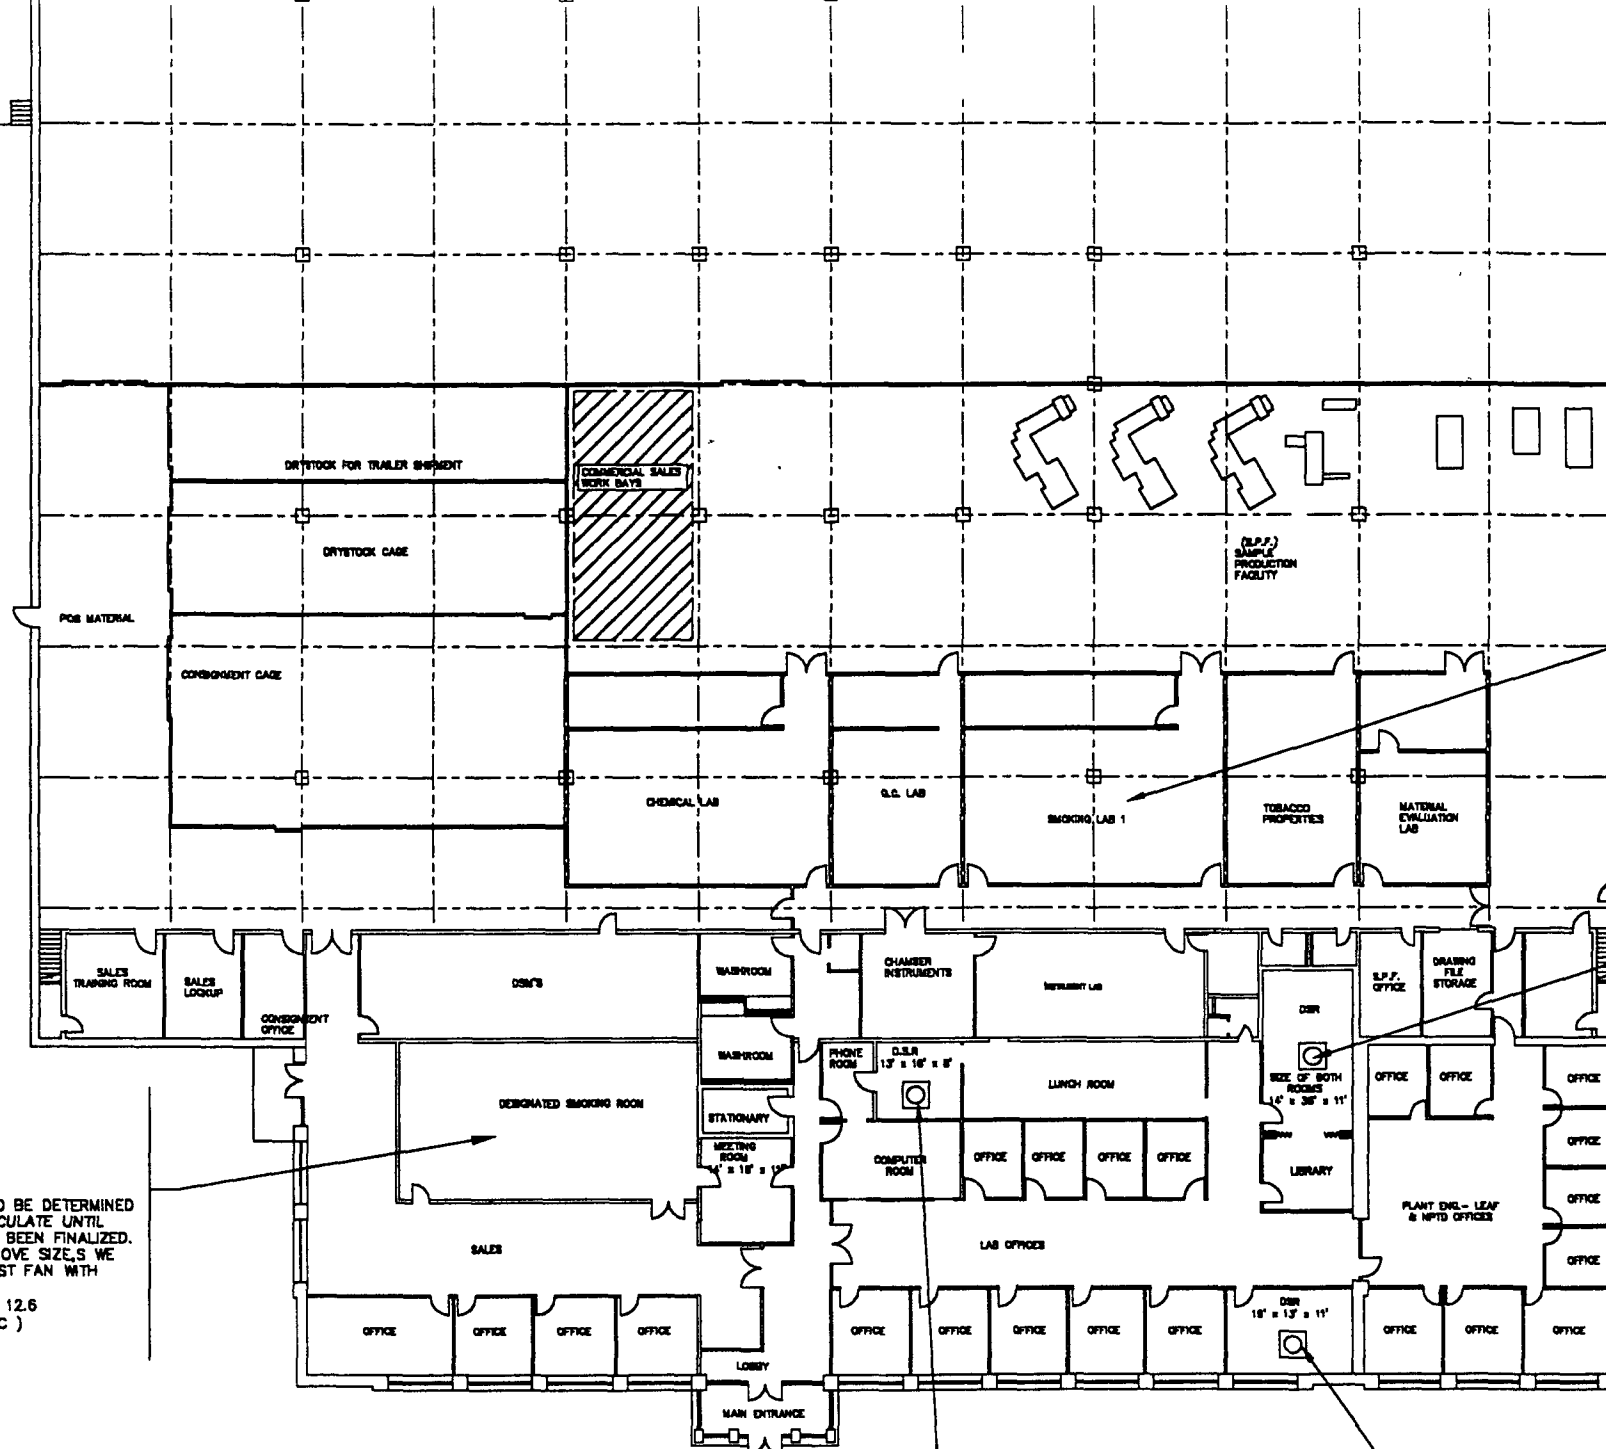
Approved as to Form and Content:


Janice Atwood-Petkovski,
Corporation Counsel &
Director of Litigation

DESIGNATED SMOKING ROOM
24' x 45' x 11'

EXHAUST FAN

-ACTUAL FAN SIZE IS STILL TO BE DETERMINED
BY ENGINEERS, UNABLE TO CALCULATE UNTIL
ARCHITECTURAL DESIGNS HAVE BEEN FINALIZED.
-IF THE ROOM IS BUILT TO ABOVE SIZE, WE
WILL THEN REQUIRE AN EXHAUST FAN WITH
2500 CFM.
OF AIR CHANGES PER/HR = 12.6
(2500 CFM = 1179.75 LIT/SEC)



SMOKING LAB - NOT A DESIGNATED SMOKING ROOM

DESIGNATED SMOKING ROOM
14' x 38' x 11'

EXHAUST FAN - TO BE DETERMINED
AIR FLOW 30 LITRES/SEC PER PERSON

DESIGNATED SMOKING ROOM
13' x 18' x 8'

EXHAUST FAN - TO BE DETERMINED
AIR FLOW 30 LITRES/SEC PER PERSON

DESIGNATED SMOKING ROOM
18' x 38' x 11'

EXHAUST FAN - TO BE DETERMINED
AIR FLOW - 30 LITRES/SEC PER PERSON

